



City Research Online

City St George's, University of London

Citation: Mahmoud, M., Ramadan, M., Naher, S., Pullen, K. R., Baroutaji, A. & Olabi, A-G. (2020). Recent advances in district energy systems: A review. *Thermal Science and Engineering Progress*, 20, 100678. doi: 10.1016/j.tsep.2020.100678

This is the accepted version of the paper.

This version of the publication may differ from the final published version. To cite this item please consult the publisher's version.

Permanent repository link: <https://openaccess.city.ac.uk/id/eprint/24703/>

Link to published version: <https://doi.org/10.1016/j.tsep.2020.100678>

Copyright and Reuse: Copyright and Moral Rights remain with the author(s) and/or copyright holders. Copies of full items can be used for personal research or study, educational, or not-for-profit purposes without prior permission or charge, unless otherwise indicated, provided that the authors, title and full bibliographic details are credited, a hyperlink and/or URL is given for the original metadata page and the content is not changed in any way. For full details of reuse please refer to [City Research Online policy](#).

Recent advances in district energy systems: A review

Montaser Mahmoud^{1,2}, Mohamad Ramadan^{3,4*}, Sumsun Naher¹, Keith Pullen¹, Ahmad Baroutaji⁵ and Abdul-Ghani Olabi^{6,7}

¹Department of Mechanical Engineering and Aeronautics, School of Mathematics, Computer Science and Engineering, City, University of London, UK

²Lebanese International University, PO Box 146404 Beirut, Lebanon

³International University of Beirut, PO Box 146404 Beirut, Lebanon

⁴Associate member at FCLAB, CNRS, Univ. Bourgogne Franche-Comte, Belfort cedex, France

⁵School of Engineering, Faculty of Science and Engineering, University of Wolverhampton, Telford, UK

⁶Sustainable and Renewable Energy Engineering, University of Sharjah, Sharjah, UAE

⁷Mechanical Engineering and Design, Aston University, School of Engineering and Applied Science, Aston Triangle, Birmingham, B4 7ET, UK

Abstract

World energy consumption has increased significantly in the last decade and for this reason several energy management strategies are currently under investigation to accommodate this high demand. In this frame, the current paper presents a review of the advances of district systems (DSs) which offers a contribution to the mission to reduce the environmental and economic impact of energy consumption. The aim of the study is to examine the potential of these systems and their ability to cope with the requirements of energy demands. Additionally, the paper reviews several optimization strategies including poly-generation, cogeneration and energy storage that could be adopted to upgrade the performance of DSs. Furthermore, the paper discusses the main obstacles facing the development of this domain and proposes some suggestions to encourage adoption of the district approach.

Keywords: District Heating, District Cooling, Renewable Energy, Energy Storage System, Waste Heat Recovery.

Nomenclature	
<i>Abbreviations</i>	
AC	absorption chiller
ATES	aquifer thermal energy storage
BDHC	bidirectional district heating and cooling
BTES	borehole thermal energy storage
CC	compression chiller
CCCP	conventional central circulating pump
CCHP	combined cooling, heating, and power
CHP	combined heating and power
COP	coefficient of performance
DC	district cooling
DH	district heating
DHC	district heating and cooling
DHW	domestic hot water
DS	district system
DVSP	distributed variable speed pump
EA	electricity adjustment
EAC	electricity adjustment capacity
EC	electric chiller
EES	Engineering Equation Solver
ESS	energy storage system
GSHP	ground source heat pump
GT	gas turbine
HEX	heat exchanger
HP	heat pump
HRSG	heat recovery steam generator
ICE	internal combustion engine
LTDHC	low-temperature district heating and cooling
MILP	mixed integer linear programming
MINLP	mixed integer non-linear programming
NG	natural gas
PGU	power generation unit
PHE	plate heat exchanger
PSO	particle swarm optimization
PV	photovoltaic
RES	renewable energy source
SNG	synthetic natural gas
TES	thermal energy storage
TEST	thermal energy storage tank

TPP	thermal power plant
TSC	thermal solar collector
TSP	thermal solar plant
WHR	waste heat recovery
WSt	water-steam
<i>Subscripts</i>	
c	cooling
e	electricity
h	heat
th	thermal

1. Introduction

Energy demand is rapidly increasing due to the combination of population growth and increased global gross domestic product per capita. Energy deliveries can be found in three different forms: heating, cooling, and electricity. The demand depends mainly on the region, weather conditions and lifestyle. The main concern is in the way of supplying energy which is related directly to the cost and environment. Thus, it is highly recommended to use renewable energy sources (RESs) such as solar [1], wind [2], geothermal [3], bioenergy [4] and marine energy [5]. Recent studies are focusing on increasing the revenues while being eco-friendly at the same time. Therefore, district systems (DSs) are proposed to cope with the contemporary requirements. Figure 1 presents the main concept of district heating (DH) which is used to supply a specific region with a hot supply line. Modern DSs often incorporate different types of RESs and mainly to produce heating and electricity [6] while decreasing the total amount of emissions [7]. For example, Huang *et al.* [8] deduced that solar-geothermal hybrid energy system is a preferable reliable solution for DH. The most frequently used renewable source energy system is the solar photovoltaic (PV) and especially in stand-alone poly-generation

microgrids [9]. Indeed, it is coupled with energy storage devices such as batteries [10], fuel cell [11, 12] and thermal energy storage (TES) [13].

Even though DSs have high capital costs, they have lower operating costs compared to that of individual systems. Currently, DSs are undertaking significant developments in different areas of the world in order to supply several forms of energy. DS is not just a simple combination, or a centralized plant used to provide the demands for a specific area, it also involves a plenty of choices concerning the energy sources, network and piping, load type, storage, etc. DSs are beneficial for both investors and the public but still need some promotions and encouragements [14]. These systems have several advantages compared to the individual plants such as decreasing the peak demand [15], achieving local sustainable and affordable energy, contributing to economic regeneration [16], increasing the average efficiency ratio and energy savings. For these reasons, numerous DSs were installed all over the world. Table 1 presents 8 successful European installations showing their locations and specifications. Most of these systems have passed through significant improvements and some of them are still currently under development. Beside these advantages of DSs, there are some barriers that these systems face. One of the main obstacles is the stochastic energy consumption from a day to another and this makes the control of the system very complex [17]. In addition, there are some other concerns that need to be taken into consideration in DSs such as time delays, pressure distributions, substation faults, leaks, outages, variable electricity prices and the nonlinear behavior of several components in the system.

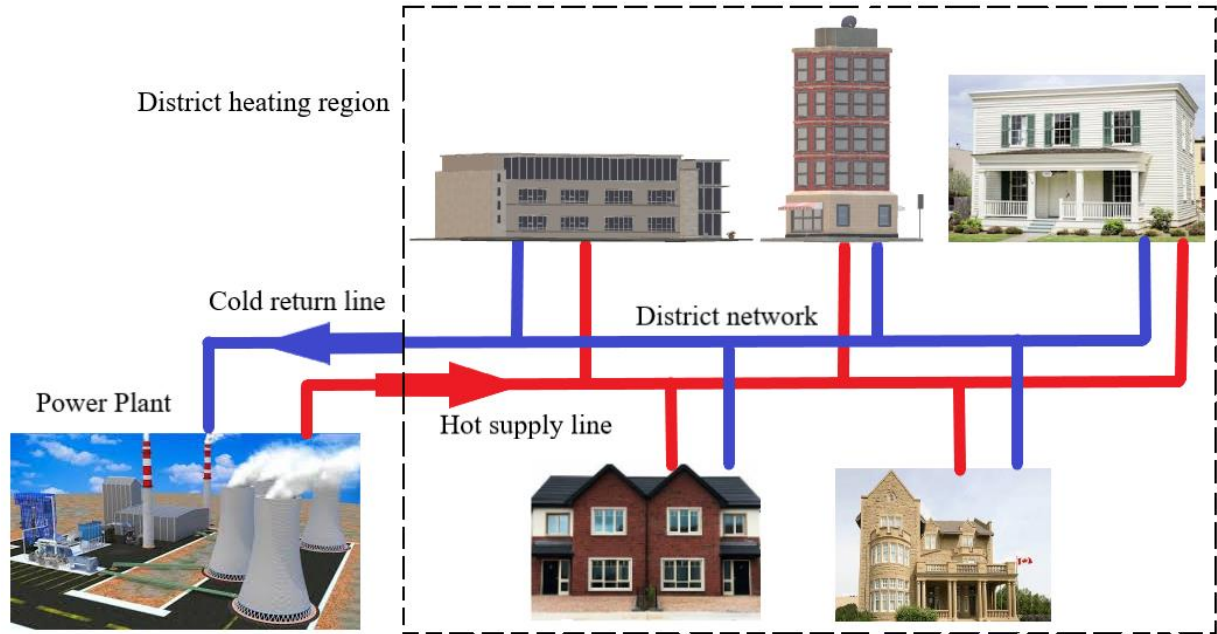


Figure 1: Principle of the district heating system

DSs could be found in different forms such as DH, district cooling (DC), district heating and cooling (DHC), cogeneration and tri-generation. These systems are not yet developed equally, for example, DH is more adopted than DC globally [18]. In order to perform an accurate analysis to size a DS, several parameters should be studied such as the required load as well as the duration of the load demand. This should also be accompanied by climate change assessment such as in [19]. The authors compared between the different combustion techniques to study the effect on climate change mitigation. DH systems have passed through five different generations: the steam, hot-temperature water, moderate-temperature water, low-temperature water (ambient DH) and bidirectional DHC (BDHC). This development was performed to overcome the problems of these systems such as the significant heat losses and steam explosion risk for the first generation or the inaccurate control for the heat demand of the second one [20]. The fourth generation was proposed to reduce the thermal losses and to decrease the need for insulation. This approach could be

also applied to DC systems. The core of this generation is to distribute water or working fluid at temperatures close to the ambient one in order to decrease the losses through the pipes and the construction cost as much as possible. The fourth generation is known recently as the low-temperature district heating and cooling (LTDHC) [21]. In [22], it was optimized to achieve a cost reduction of 40% which could be performed by allowing the exchange of heat and electricity between the buildings. The latest generation which is the fifth one is known as bidirectional DHC, it is able to provide both heating and cooling loads simultaneously to the consumers with a decentralized control system [23, 24]. Abugabbara *et al.* [25] stated that the importance of the fifth generation is that the customer could be a customer and a producer at the same time. This concept will be more explained in section 2.3. One of the main differences between old and modern DSs is the hot/cold metering. Previously, consumers were used to pay a flat rate since the systems were unmetered. The consumption charges were based on some factors such as occupancy and size. However, this was found to be not fair enough and thus, metering devices were introduced to the newer systems. This could also be helpful in the DS assessment to perform further enhancements. For example, it will be easier to monitor energy demands and fluctuations [26]. Similarly, in residential heating applications, it was found that a huge amount of heat is wasted due to the poor control systems and regulations. Liu *et al.* [27] suggested to install a calorimeter in each building and on-off control valves in each household. This will help in measuring the total heat consumption of the building and will provide an accurate individual control.

The current study reviews the advances in DSs and the development of this domain. This is carried out based on the techniques, network, strategies, control, and capacity of several

case studies performed all over the world. The review also provides a comparison between the different configurations of DSs. This spots the light on the optimal path/strategy of DSs to reduce energy consumption.

Table 1: European district energy systems installations

Location	Year	DS	Size/Capacity	Supply/Source
Drammen, Norway [28, 29]	2011	DH	15 MW	HP
Flensburg, Germany [30]	1974-2013	DH & power	90,000 inhabitants and 1,800 of a neighboring city	CHP, coal & NG
Malmö, Sweden [31]	2001	DH & power	250,000 MWh/year	Geothermal, wind, solar & biomass
Ramsund Naval Base, Troms, Norway [32]	2011	DH	600 kW	HP (COP = 2.7)
Sheffield, UK [33, 34]	1960	DH & power	60 MW _{th} & 19.3 MW _e	CHP & NG
Southampton, UK [35]	1986-2008	DHC & power	40 GWh _h , 22GWh _e 8 GWh _c (per year)	CHP, boilers & geothermal
Stockholm City, Sweden [36]	1995-2000	DC	170 MW _{th} (240 GWh/year)	HP/refrigeration
Turin, Italy [37, 38]	1980	DH & power	Base load (1200 MW _e , 740 MW _{th}), peak periods (+1,100 MW _{th})	CHP

2. District System Strategies

The importance of enhancing district systems outweighs that of individual plants taking into consideration the difference in emissions and costs of these systems. Thus, all optimization methods should be studied before starting the construction of the system. Additionally, it is worth to mention that DSs are more beneficial and economic when used for regions of high population density [39]. This section will present a review of the recent types of DSs as well as their corresponding developments. Table 2 summarizes all district systems reviewed in this paper excluding those with insufficient data.

Table 2: Summary of the district systems reviewed in the current study

Location	Year	DS	Size/Capacity	Solver/Method	Supply/Source	Objective(s)
Barcelona, Spain [40]	2013	DHC	3.102 MW _{th} & 3.354 MW _e	-	CCHP, GT, solar and biomass	Introducing Poly-generation to save energy
Barcelona, Spain [41]	2018	DH	1 MW (Data center)	TRNSYS	NG, biomass, HP & WHR	Reusing the heat wasted from a data center
Beijing, China [42]	2019	DH	50 kW _h	Aspen Plus	Gas-fired HP & WHR	Recovering the wasted flue gas heat from a gas-fired
Bottrop, Germany [43]	2017	DH	550 kW _h	Modelica	CHP	Performing a full-dynamic exergy analysis
Changsha, China [44]	2016	DHC	50 MW _h & 101 MW _c	Integer-coded genetic algorithm	HP	Determining the optimal pipe diameter
China [45]	2014	DHC	-	MATLAB	Wind, solar & gas	Energy saving and cost reduction
Colorado, USA [24]	2019	BDHC	-	Modelica & EnergyPlus	HP	Investigating the importance of the fifth generation of DHC
Copenhagen, Denmark [46]	2019	DH	200 MW	-	CHP, wind & biomass	Flexibility of CHP
Croatia [47]	2012	DH	35 MW _h & 16-38 MW _e	-	CHP, ICE, NG & biomass	Comparison between individual and district cogeneration
Galicia, Portugal [48]	2018	DH	18 MW _h	Methodology	TSC & biomass	Achieving cleaner production using RESs
Green Island, Taiwan [49]	2019	DC	756 kW _c	-	WHR & AC	Activating a DC via WHR system in Islands
Japan [50]	2017	DHC	32.5MW _h & 27.2 MW _c	MILP-PSO	NG & CHP	Auction is introduced to reduce the price of electricity
Lisboa, Portugal [51]	2017	DHC	22MW _h , 28 MW _c & 5 MW _e	-	GT, HRSG, WSt-HEX, AC & CC	Producing sub-products such as char, SNG and synthetic gas
Lisboa, Portugal [52]	2017	DHC	35 MW _h , 29 MW _c & 5 MW _e	MATLAB & e!sankey	GT, HRSG, chillers & WSt-HEX	Upgrading an existing DHC by producing sub-products
Lower Saxony, Germany [53]	2015	DH	175.225 MW _h	MILP	Biomass & CHP	Bioenergy villages assessment
Madrid, Spain [54]	2013	DHC	1.5 MW _h , 7 MW _c & 2.19 MW _e	-	NG, TSP & AC	Decreasing the CO2 emissions via TSP
Malaga, Spain [14]	2017	DHC	20.45 - 21.4 MW	EnergyPlus	CCHP	Promotion of the DHC technologies via CCHP
Mississippi, USA [55]	2019	DC	21.45 MW _c	CVODE	HP	Studying the control strategy of TES
Monterusciello, Italy [56]	2017	DHC	16MW _h & 22 MW _c	TRNSYS	Solar-Geothermal-Biomass	Adopting DSs based on hybrid RESs

Naples, Italy [57]	2015	DH	8.1-9.2 MW _{th} & 7.8-9.1 MW _e	-	CCHP, NG & biomass	Investigating the use of trigeneration in DH
Okotoks, Canada [58]	2019	DH	2293 m ² (TSC), 240 m ³ (water tanks)	TRNSYS	TSC & NG	Studying the performance of solar DH with TES
Parma, Italy [59]	2013	DH	191,330 people	WINDIMULA3	Waste incinerator	Comparing between waste incinerators and domestic boilers
Poland [60]	2013	DH	200 MW _h	EES	Biomass & CHP	Choosing the optimal coefficient of the share of co-generation in DSs
Pongau, Austria [61]	2017	DHC	-	Modelica	NG	Dynamic thermo-hydraulic pipe model for DSs
Risch Rotkreuz, Switzerland [62]	2019	DC	50 kWh (Storage)	MILP	TSC, PV, chillers & CHP	Using heating units during their off periods to support DC
Risch Rotkreuz, Switzerland [22]	2018	DH	90.98 kW _{th} & 26.2 kW _e	MILP-GAMS CPLEX	PV & CHP	Investigating the effect of energy reciprocity
San Francisco, USA & Cologne, Germany [63]	2017	BDHC	10 MW _h	Modelica	HP, NG & TSP	Comparing the BDHC with DH and stand-alone cooling
Seoul, South Korea [64]	2018	DHC	30 MW _c	MATLAB	CHP	Implementing bi-lateral heat trades
Shijiazhuang, China [65]	2017	DH	790.5 MW _h	Testing	WHR & HP	Comparing WHR with coal-fired and gas-fired boilers in DH
Spain [66]	2015	DH/DC	2-9 MW _e	EES	CHP/CCHP & biomass	CCHP vs CHP
Tehran, Iran [67]	2016	DHC	500,000 m ² , and 137 buildings	EnergyPlus	GT, PV, CCHP, AC & CC	Determining the optimal capacity and operation
Tianjin, China [68]	2017	DHC	16.765 MW _c	MATLAB	CCHP, EC & GSHP	Design and actual load comparison in an optimal operation strategy
Turkey [69]	2015	DH/DC	11.5-152.3 MW _{th}	EES	CCHP	TPPs conversion to co/trigeneration for DSs
Tuusula, Finland [70]	2019	DH	231 MW _h	CPLEX & Ipopt	CHP	Investigating the effect of network storage in DH
Visoko, Bosnia and Herzegovina [71]	2019	DH	13 MW _h	EnergyPRO	Solar, NG, biomass, CHP & HP	Investigating DH based on RES
Xinghai Bay, China [72]	2010	DHC	84.5 MW _h & 95 MW _c	Genetic algorithm	HP	Using Genetic Algorithm to find the optimal design
Yatagan, Turkey [73]	2010	DHC	30 MW _{th} & 630 MW _e	-	Coal (Lignite)	Converting TPP to trigeneration plant as a DS

2.1 Waste Heat Recovery

There is a huge amount of heat wasted yearly from energy related systems, this waste being substantially higher than that utilized by residential and commercial buildings. There is another critical source of heat waste which is from the industrial sector and thus it could be recovered to be used for DH [74, 75]. The powerful point of this source is its availability without constructing a new plant because waste heat recovery (WHR) systems can be integrated by just retrofitting the existing power plants [76]. The wasted heat is usually considered as a low-grade heat source and especially when the temperature is below 100°C. In this case, it is highly recommended to use the trilateral flash cycle in order to recover the wasted energy efficiently [77]. Figure 2 summarizes the different types of WHR that could be coupled to DH systems. There are mainly three types of incorporations: heat wasted from the industrial sector, waste incinerators and if there is a source of heat waste between the substations. It is important to draw different connections for the WHR and DH combinations to study the potential of this system in order to compare between the alternative paths especially because of the long-distance connections. Industrial heat recovery has the ability to supply a DH system via centrifugal heat pump (HP) with 40.3 % of the operating cost of a gas-fired boiler [65]. The overall coefficient of performance (COP) of the proposed DH system could reach 4.8 with a 60.6 % and 56.3 % CO₂ reduction compared to that of coal and gas, respectively. Before constructing an industrial WHR-DH system, it is necessary first to perform a risk assessment study concerning its termination. However, in [78], it was concluded that most industrial heat recovery systems were terminated due to the replacement with other heating sources and not because of the termination of the recovery systems. Beside the industrial applications, recovering the flue

gas heat of a gas-fired absorption HP is able to increase the COP, energy and exergy efficiencies and decrease the payback period of DH [42]. In some cases, WHR cannot be considered as a primary source for DH, this may occur when the wasted heat is between the supplied sub-stations or when it is insufficient. In this case, heat recovery could be used to reheat the return line of the DH to be supplied again directly such as in the presence of air cooled data centers between two sub-stations [41]. HPs must be placed to extract the wasted heat from this center to the return line allowing it to reach the supply line temperature. In DH, waste incinerators provide additional energy supply that are found to be good alternatives to domestic boilers [59]. Even though these incinerators produce pollutants, but they could be controlled by filters for instance. On the other hand, domestic boilers are already producing harmful emissions. The only one issue to be monitored is the legal limits of incinerators' emissions. Managing WHR from waste will reduce the demand for landfilling, emissions, and fossil fuel consumption. In [79], two types of ventilation were compared in a DH system: heat recovery ventilation and exhaust air HP ventilation. The former preserves a low return temperature when compared to the latter while the exhaust air HP has the ability to provide domestic hot water in summer which means that there is no need for DH in this season. Wang *et al.* [80] presented the key elements and possible approaches for optimizing WHR-DH. One of the important results was to use multi-heat source (hybridization). In remote islands, WHR could also be used to activate DC such that by recovering the waste heat from a diesel generator which is usually the most used power supply source. The main factor affecting the efficiency of the proposed system is the design temperature of the cooling tower. This system has a payback period of around 4 years as well as it consumes less electricity and emits low amount of CO₂ in

comparison with the window-type air condition [49]. The second critical parameter in cooling systems is the water flow rate [81]. It is very necessary to optimize the flow rate and especially the wasted water released to the natural reservoirs due to its significant environmental impact [82].

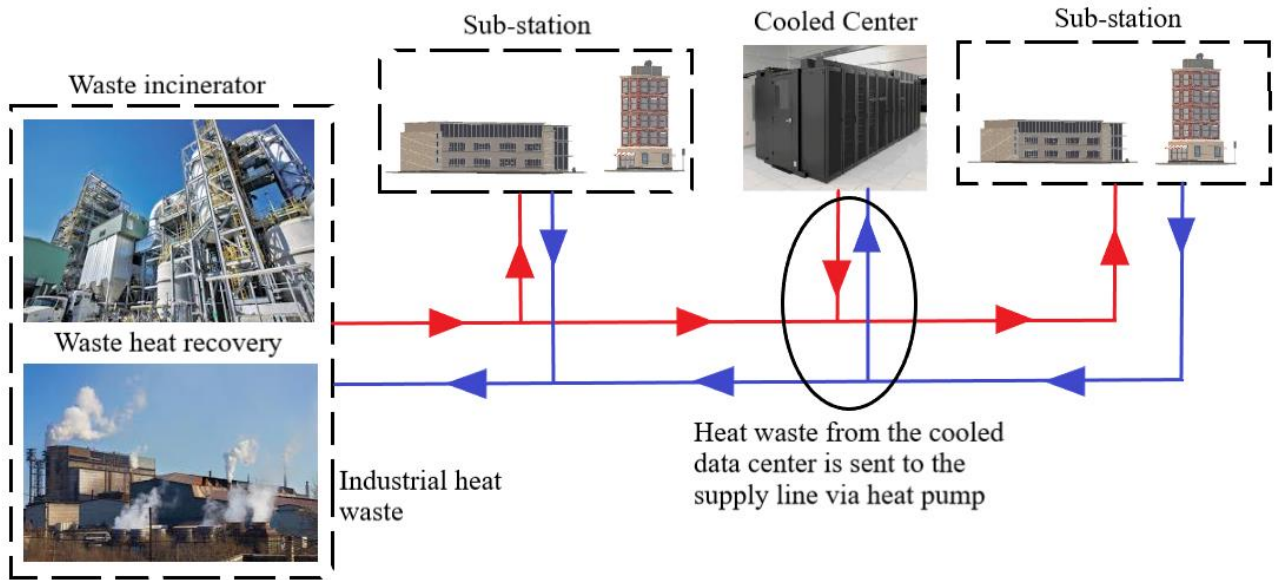


Figure 2: Waste heat recovery incorporated with DH

2.2 Poly-generation and Hybrid Systems

Hybridization is a term used when different sources of energy are combined as shown in Figure 3 which is an example of a hybrid system studied in [68]. The case study was performed in Tianjin (China) to compare between the design and actual load in an optimal operation strategy. The total cooling capacity is assumed to be 16.765 MW such that each electric chiller (EC), ground source heat pump (GSHP) and the combined cooling, heating, and power (CCHP) could supply 4100 kW, 3550 kW and 1465 kW, respectively. The maximum cooling capacity could reach 21.965 MW during peak loads by the help of TES which provides additional 5200 kW. Usually, poly-generation is accompanied by

hybridization due to the necessity of using multi-energy sources for supplying different energy demands. The main advantage of these systems is to provide different utilizations in order to increase the overall efficiency of the plant. Most energy sources used for DSs are fossil fuels due to their abundance and flexibility in control. Fossil fuels have several drawbacks such as air pollution, high emission rates and ozone layer depletion. For this reason, refuse incineration and gasification derived fuels [83] are introduced beside the DS in order to produce other products such as synthetic natural gas (SNG), synthetic gas (syngas) and char. According to [52], the highest exergy efficiency and the lowest cost can be obtained from DS if char and syngas are used. Recently, the production of fuel from wastes is a very important technique to reduce the negative environmental effects and consumption cost at the same time [84]. Thus, it is very crucial to apply the fundamentals of pyrolysis in waste management in order to produce secondary raw materials or to be used in energy related systems [85, 86]. Kabalina *et al.* [51] found that producing these sub-products will help in decreasing the payback period which is expected to be 3 years. As a matter of fact, the production of the sub-products will cause a reduction in heating, cooling, and electric loads. In [40], it was found that the poly-generation plant has the ability to reduce the CO₂ emissions to 24% compared to the conventional one. The modern poly-generation plants and hybrid systems very often integrate RESs [87-89] such as in [56] where solar, geothermal and biomass energies were incorporated to achieve a 75% energy saving compared to the traditional systems. In order to decrease the capital cost of poly-generation plants, it is recommended to use the heating units that are off during summer to drive DC by the help of additional RES such as solar energy [62].

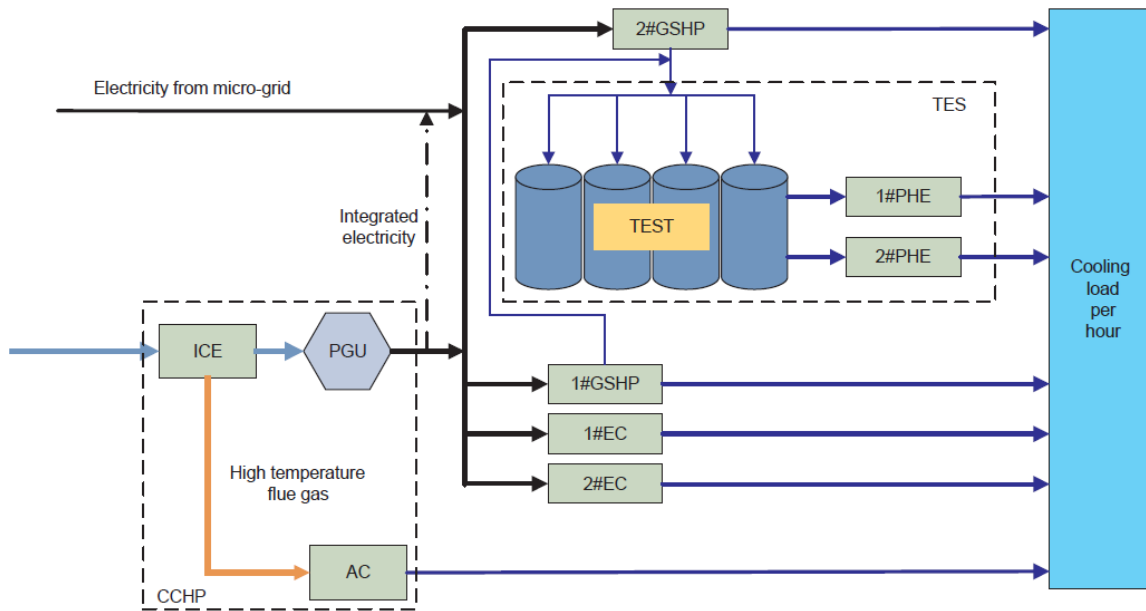


Figure 3: Hybrid system; GSHP, power generation unit (PGU), internal combustion engine (ICE), plate heat exchanger (PHE), thermal energy storage tank (TEST), absorption chiller (AC) and electric chiller (EC) [68]

2.2.1 District Systems Involving Co-generation

Co-generation is the production of two different outputs which is known also as combined heating and power (CHP) [90]. These plants are widely used in DSs to provide space heating, domestic hot water (DHW) and electricity for a specific region. CHP plants are flexible and able to provide two forms of energy while depending on different supplying sources [46, 91]. Figure 4 presents a cogeneration plant such that heat is extracted between the different levels of turbine to provide district heating. In order to show the potential of this incorporation, in Turkey [69], a simulation study was carried out using Engineering Equation Solver (EES). The main objective was to investigate the conversion of existing thermal power plants (TPPs) into co/tri-generation plants. One of the studies involved in co-generation plants is the bilateral trade [64] that uses the surplus of heat generated by the CHP plant to either store the energy if needed or to activate an absorption chiller for cooling

in summer. Many conventional plants are nowadays converted into co-generation ones to decrease the expenses of the power plants and electricity consumption [92] and to increase the plant efficiency. According to a case study performed in Croatia, it was reported that biomass-fired plants can save energy more than that of gas-fired plants [47]. In [53], bioenergy villages were studied as an optimization approach for CHP where crops and liquid manure were used from local farmers as a feed stock for the biogas plants in Lower Saxony (Germany). The maximum capacity achieved was 175.225 MW_h, and the study was based on mixed integer linear programming (MILP).

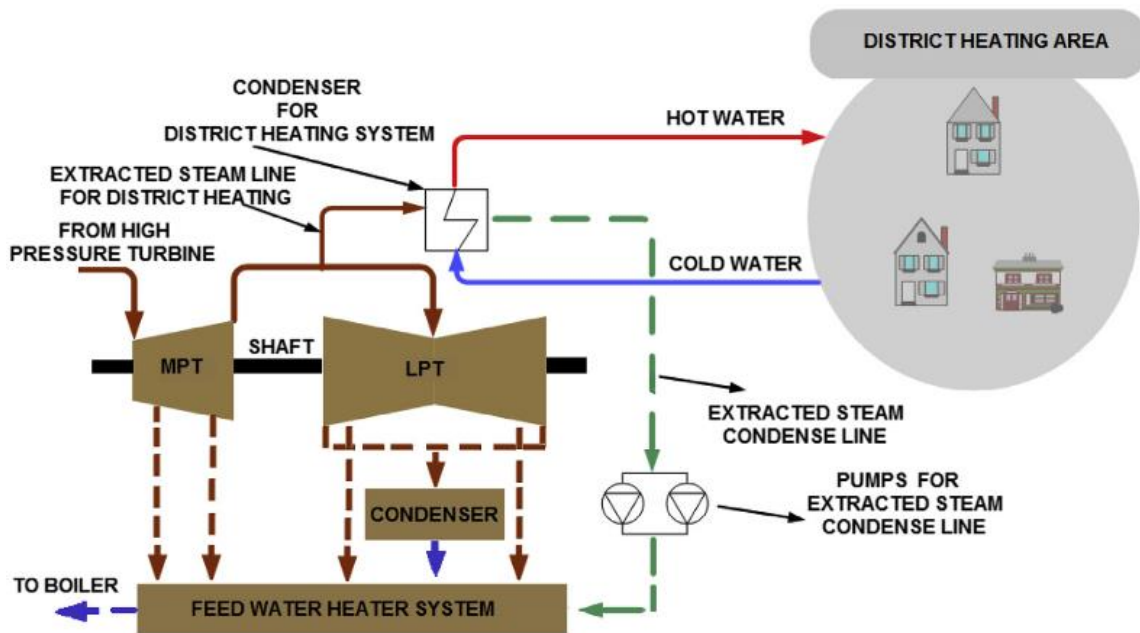


Figure 4: Cogeneration plant based on a Rankine cycle [69]

2.2.2 District Systems Involving Tri-generation

Tri-generation is the generation of three different demands which is also known as CCHP [93-95] (see Figure 5). It is used as a solution for the imbalance between summer and winter in cogeneration plants by introducing DC such that the waste of energy can be utilized for cooling. In [66], the authors concluded that replacing CHP by CCHP is better only when

there is high summer severity and if it is operating at full load. The study was based on Spanish cases using EES as a solver. It was deduced that if the population is between 10,000 and 20,000, the capacity of the plant must vary between 2 and 9 MW. In this case, CCHP plant size becomes smaller and CO₂ emissions will be reduced. Several studies were performed in order to convert existing TPPs to tri-generation DSs [73]. This can be done by extracting a portion from the steam to be used for heating as an example, but this conversion must not affect significantly the performance of the power plant or cause an increase in the fuel consumption [69]. This system can increase the plant revenue and decrease its CO₂ emissions. Having said that, in order to produce different outputs, it is necessary to construct a hybrid system to provide the three types of loads. It is also preferred to introduce RESs [57] to the tri-generation plants such as a thermal solar power [54] which can help in decreasing the emissions of the plant and increase energy savings.

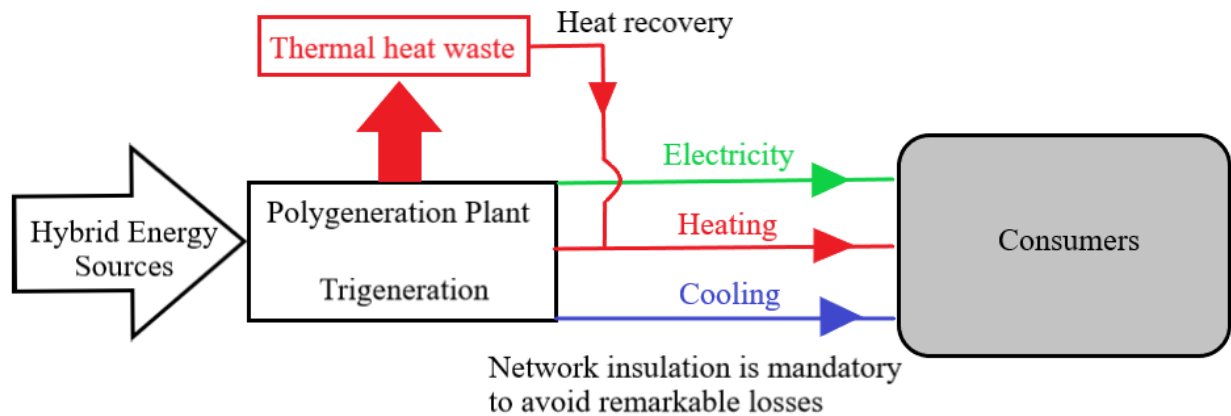


Figure 5: Tri-generation plant or CCHP

2.3 Bidirectional DHC

The most recent type of DHC network investigated is the BDHC system which is the fifth generation of DSs. It uses a single circuit for providing heating and cooling. The system circulates in one direction depending on which is more needed as a net (cooling or heating),

either from the central plant or in the opposite direction. This also provides an ability to use the heat wasted from the buildings directly. Moreover, each building has its own HP to control its chilled and water loops (see Figure 6). Bunning *et al.* [63] compared a bidirectional low temperature network to gas-fired DH. The authors deduced that, by means of optimization of the BDHC system, this allowed the primary energy consumption to be reduced by between 58 % and 84 % depending on each specific case. This is also accompanied by significant CO₂ and energy cost reductions. The study was carried out using Modelica such that the total heating capacity was 10 MW, and supplied via HP, natural gas, and a thermal solar plant.

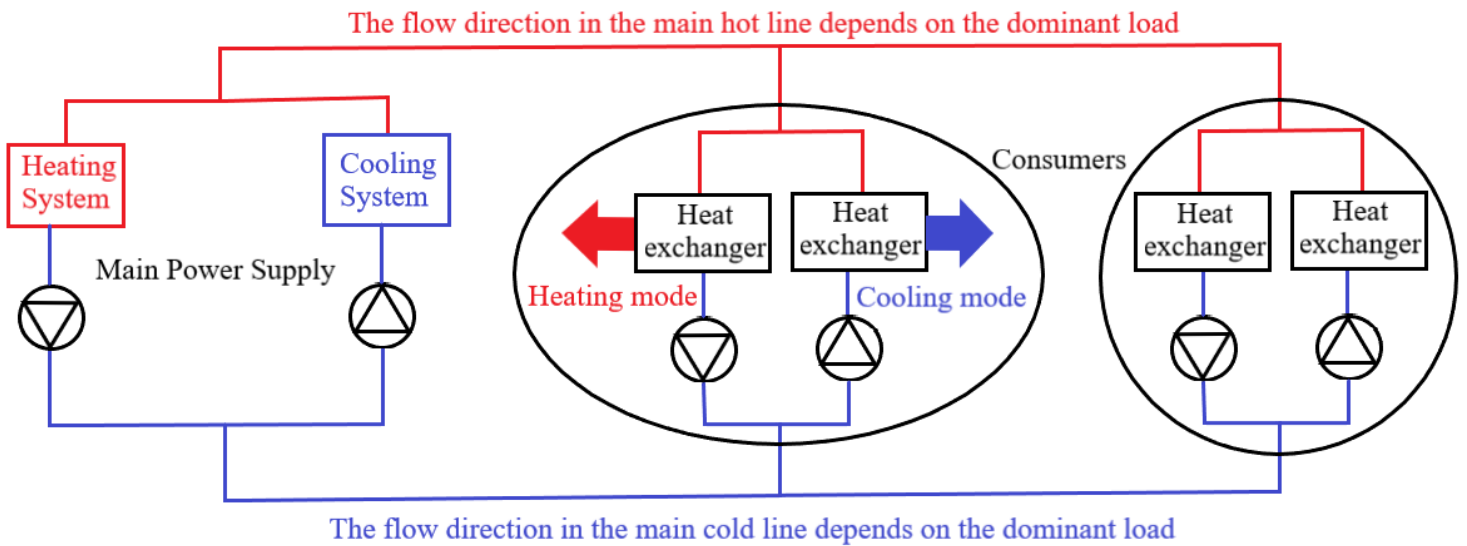


Figure 6: Bidirectional DHC system

3. Energy Storage for District Systems

Provision of an Energy Storage System (ESS) is a solution for many barriers faced by a DS. For example; TES [96-100] can be used to support the central plant during peak hours, control and provide good management, increase the efficiency and decrease the operating

cost. In [101], a liquid air energy storage system was investigated to store the electricity in the form of liquid air during off peak hours. This liquid will be pressurized, vaporized, and superheated in a combustion chamber and finally used to feed the DHC. There are three types of district energy storage: network storage, storage devices and thermal inertia of buildings. The characteristics of these storage techniques are presented in Table 3. The first mentioned type is the network storage which can be controlled from the main system; however, it is accompanied by high thermal stresses and fatigue of pipes due to the high changes in temperature. There are some other storage devices that have been frequently used in remote islands and especially when depending on solar and wind energies [102]. In these cases, mechanical ESSs are highly recommended due to their fast response and nil effect on the environment. They are divided mainly into three types; flywheel [103], pumped hydro [104] and compressed air [105] energy storage systems.

Table 3: DHC Storage Techniques

Energy Storage Type	Storage Techniques
Network Storage [70]	Storing energy in the system's equipment
Storage Devices	Sensible, latent, borehole TES (BTES) [106], aquifer TES (ATES) and ice storage [107]
Thermal Inertia of Buildings [108, 109]	Changing the set point temperature of the building while ensuring a comfortable range

4. Design and Calculations

The design, network and piping are the parts related to the construction and organization of the DS which affects the performance and efficiency of the system. This is a very

important segment in these systems in which it can increase directly the energy saving and help in the load's regulation. Therefore, a pre-study is always needed before developing the DS which may involve weather forecasting and estimations fluctuation of loads in order to select the optimal diameter for the pipe network [72]. In [110], DHC models were reviewed to highlight the fast modelling techniques for these systems. The most modern model used to accurately study the district systems is the dynamic thermo-hydraulic pipe model [61].

4.1 Control and Network Regulation

Control strategies are mainly investigated for achieving an optimal distribution of the different loads, peak shaving, increasing efficiency, decreasing the temperature difference between heating and cooling networks. One of the main network concerns is the flexibility which aims to speed up or delay the injection and extraction of heat to achieve a reduction in capital expenditure and operating expenses. This term is studied to solve problems faced due to the type of energy source such as the intermittent nature of RES. DHC regulations are performed to decrease the operating cost. In this frame, two methods that are the Electricity Adjustment (EA) and Electricity-Adjustment Capacity (EAC) were proposed in [50] as electricity regulation techniques to support the whole operation of the system. The authors found that the EA method can decrease 1% of the nominal operational cost while that of the EAC is 2%. Determining the optimal diameter will contribute in reducing the cost of the DHC piping network. In [44], two piping networks were studied; the conventional central circulating pump (CCCP) and the distributed variable speed pump (DVSP), as shown in Figure 7. As a result of the study, the annual equivalent cost of the DHC using DVSP was approximately 25% lower than that of the conventional one. Energy

source integration is considered as a control strategy because the system will be more flexible having a fast response. A typical example is studied in [45] where the suggested system incorporates wind energy, solar energy, and natural gas.

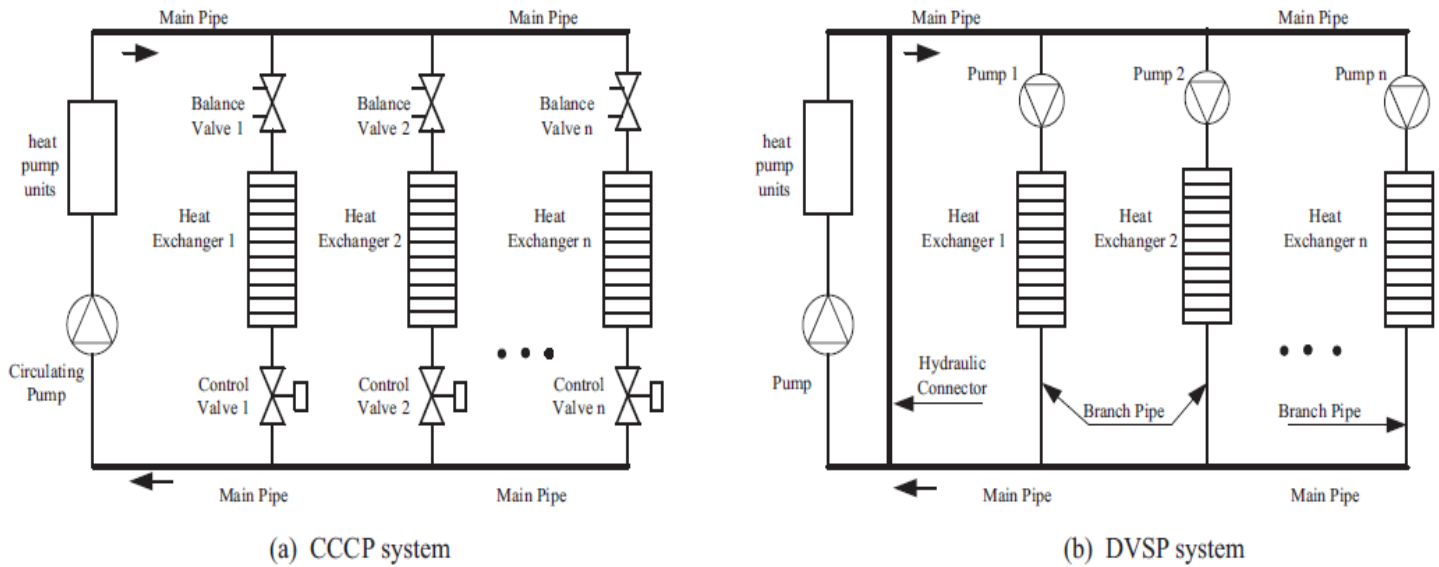


Figure 7: A schematic diagram for the CCCP and DVSP systems [44]

4.2 Simulations

Several studies have been performed in order to achieve the optimal design for the DSs while optimizing the calculation and simulation techniques due to the complexity analysis of these systems [60]. Simulations and calculations are very critical in DSs which will contribute to figuring out the difference between design and actual loads [68], obtaining the optimal operation strategy, performing a thermal environment measurement and air pollution study. The two most popular optimization methods used in DHC systems are the MILP [67] and mixed integer non-linear programming (MINLP) [111]. These approximate solutions are used to cope with the nature and characteristics of the output to minimize the

operating cost mainly and optimize the amount of energy consumed because it is very hard to model it accurately due to the many variables involved.

5. Discussion

District systems have showed several advantages compared to the individual systems from different aspects: economical, environmental and energy savings. The development of such systems is rapidly increasing these days which can be noticed from the increasing number of research studies devoted to this concept. This conclusion reflects the great potential of the DSs which is expected to be spreading more and more in the future.

District Systems' Specifications

One of the major principles of the district system is the centralization which is opposite to the operational mode of an individual plant. Consequently, when the control is preformed from a central organization, the energy losses and fuel consumption can be monitored, controlled, and reduced leading to significant energy savings. DSs are among the optimal solutions for reducing pollution taking into consideration that its footprint is one of the most crucial issues in energy domain. Furthermore, these systems focus on increasing the penetration of renewable energy which will also help in decreasing the amount of emissions. The efficiency and performance depend mainly on the used energy sources, characteristics of the load, storage system and network topology. DSs have high efficiencies because of the combined sources adopted (hybrid systems) and the different types of demands to be supported (poly-generation). The start-up cost is usually added to the operating cost and especially when the plant is not working for a long time. This is a major problem faced by the individual cooling, heating, and power systems where the

operating costs are very high due to the losses generated during the start-ups and shutdowns. This problem is almost eliminated in DSs because the central plant is always running and feeding the consumers. In addition, the operating cost is also reduced in the case of district systems due to the energy savings resulting from the mentioned energy strategies.

Optimization Methods

In all energy studies, optimizations aim to achieve almost the same objectives such as to increase efficiency, reduce CO₂ emissions and energy losses, and increase the economic profits. The issue stands behind the techniques that should be considered to attain the mentioned objectives which may differ from one case to the other. Figure 8 presents the methodology and methods that need to be followed for adopting optimal DSs. Indeed, such techniques include, poly-generation, waste heat recovery, energy storage and renewable sources of energy [71]. An optimal DS is a hybrid system that combines RESs and WHR to provide the needed requirements, decrease the pollutant emissions and reduce the operating cost. These sources could be used as primary sources or supplementary otherwise if they exist between the substations to reheat the return line directly in case of DH [41]. WHR has also the potential to improve DC by activating the absorption chiller cycle [49]. Waste incinerators are able to decrease the operating cost of DSs, fuel consumption and need for landfilling, however, it must be controlled in order to work within the legal limits of emissions. The red arrows in Figure 8 refer to the flow of energy which starts at the TPP station and ends at the buildings/consumers. At first, the hybrid system will be used to produce the required forms of energy via a poly-generation plant. It will be then connected to the BDHC network to supply the consumers by passing through the decentralized control

systems. It is also necessary to make sure if there is a source of heat waste between the substations of the DS to be recovered. During off-peak loads, ESSs could be used to store the excess of power to be supplied again when needed during peak loads. The stored energy could either be supplied directly to the consumer or to the decentralized control system before. This depends on the type of storage technique such that if it is stored within the building thermal inertia, then it will be directly used by the consumer.

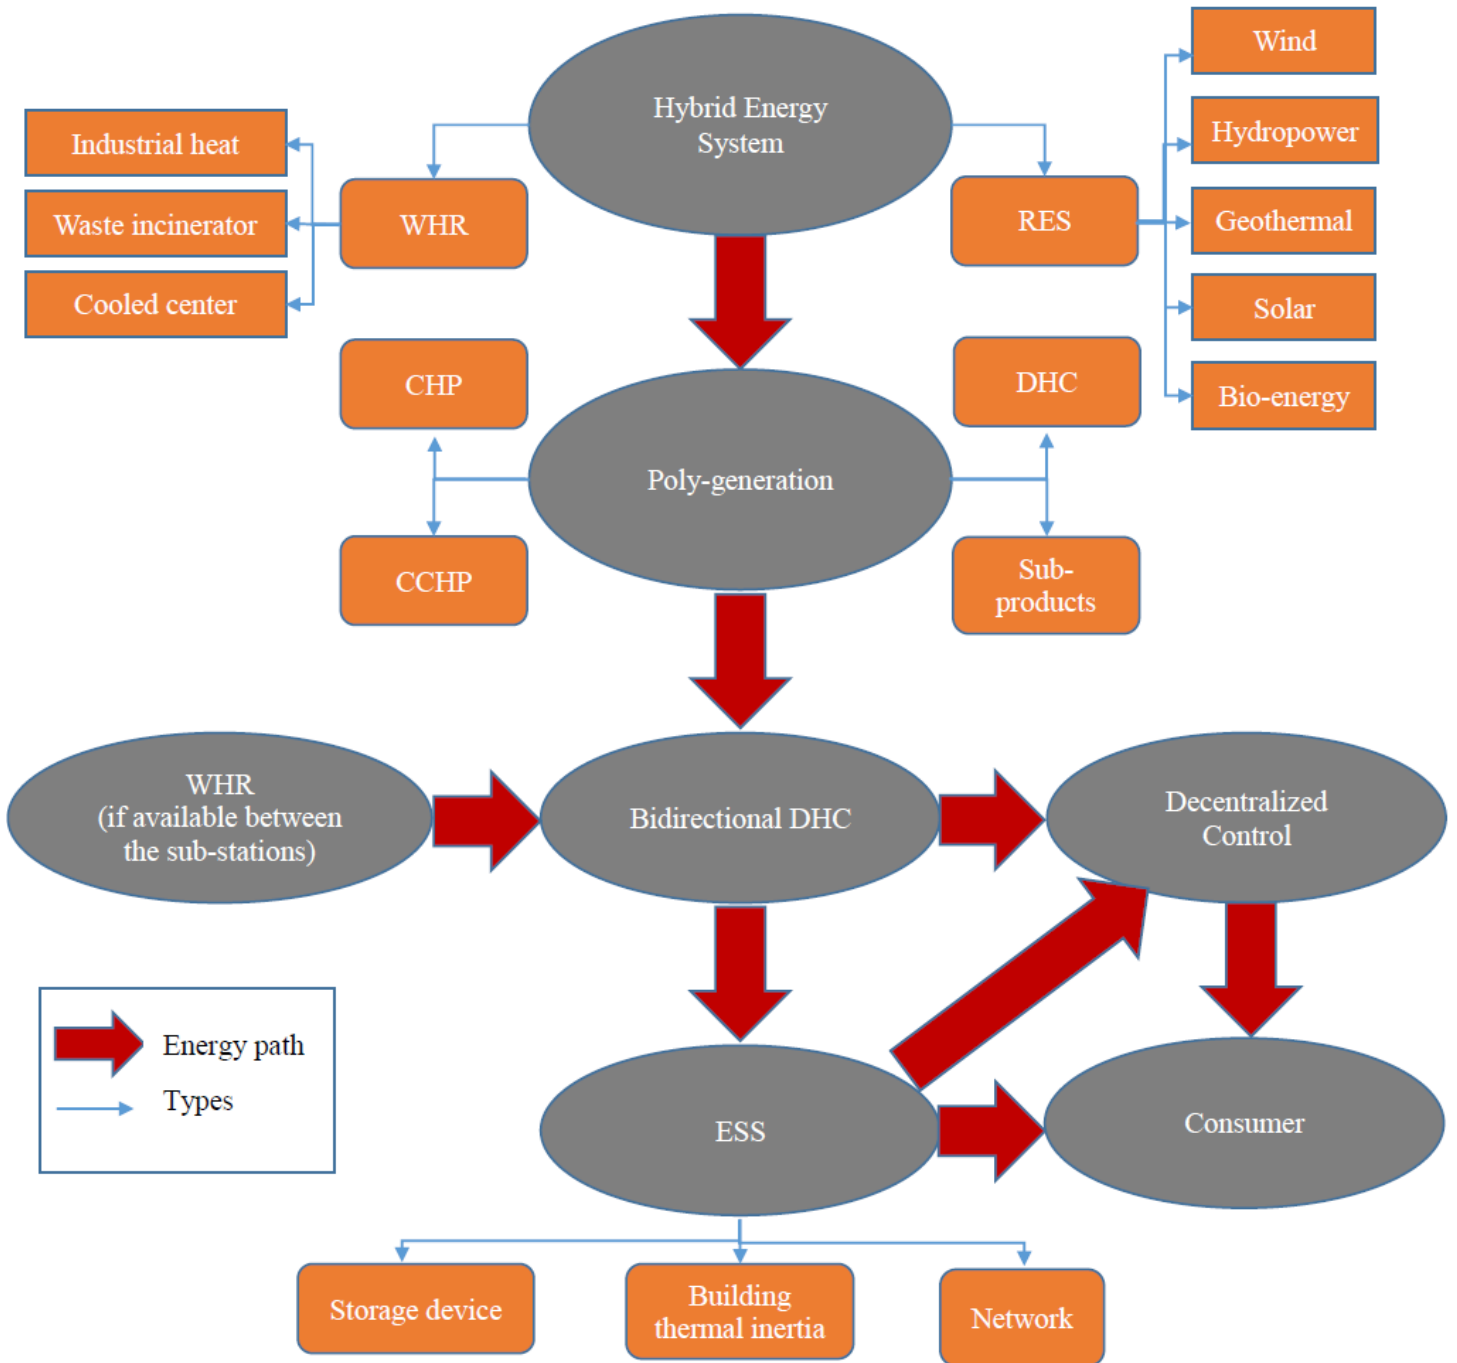


Figure 8: Optimal path for district systems

DS barriers and recommendations

The concept of DSs is still under development and it is facing some impediments that are hindering its growth. Not all these impediments are considered as disadvantages, but

society does not have the ability to cope with new ideas easily. In some countries, fuels are found abundantly with low prices. Therefore, these countries do not have the same motivation as in the countries suffering from high fuel cost. District systems have high capital costs compared to the individual ones due to the massive equipment used and the construction of lengthy piping for distribution. In addition, the long network of pipes potentially causes large energy losses which imposes a need to use efficient insulation that will be also added to the initial cost of the whole system. The imbalance between the different consumers' demands and significant fluctuations of the loads lead to complexity in the system control. In addition, the loads are not the same neither among different buildings nor during different periods of the year. Therefore, various control strategies need to be investigated and studied for each district system alone due to the uncommon conditions between the DSs. This control must be based on a demand-side management (DSM) [112] to ensure its economical sustainability. Finally, it is recommended to build BDHC in order to decrease the overall losses. In such DSs, ESSs are very crucial such that network [70] and thermal inertia of the buildings [108] are used for short duration storage while BTES is favorable for seasonal storage [106]. It is also necessary to study and optimize the wall insulation of the buildings to determine the optimal thickness [113] in order to reduce the total energy losses.

There are two ways in which the governmental sector can encourage uptake of DSs, firstly by providing investors with the required information and special tools for construction and, more directly, by decreasing taxes on DSs to make them more economically feasible. Another method is to decrease the capital cost of the district system which mainly depends on the piping and network. This could be achieved by reducing the pressure inside the pipe

and hence minimizing the pipe wall thickness [114]. DSs should be more publicized and promoted to highlight their benefits for the investors. Indeed, this is a crucial point because there are still some hidden issues concerning the district concept that make people hesitate in adopting such approach. Retrofitting the existing power plants provide several benefits from environmental and economic aspects. In other words, if there exist a power plant, it is more beneficial to improve it than constructing a new DS to avoid the high capital cost of these systems. Enhancing the conventional plants also helps in reducing the gas emissions and thermal environmental pollution.

6. Conclusion

The District Systems concept has received increased adoption recently, providing both heating and cooling loads. The performance of these systems was found to be principally dependent on the energy source used. The integration between the different sources is an effective way to improve the efficiency of the system. Fluctuations in energy demand within different locations or for the same location but at different time-period are among the main technical problems that should be tackled when adopting district systems. Among the solutions are ESSs such as network storage, thermal inertia of the buildings and storage devices. The heterogeneous characteristics of the demand profile raises a major problem of DSs that is the complexity of control to ensure an optimal supply to each residence. In this frame, DVSP and BDHC systems were found to offer good solutions. The economic and environmental quality of DSs could be improved by incorporating renewable sources and heat recovery systems. WHR has a great potential to support the district line; either as a primary source or as a secondary one placed between the substations. The latter is based on reheating the return line to be supplied again directly. Waste incinerators are found to

be good alternatives to domestic boilers in order to decrease the total emissions, cost and the need for landfilling. Further studies should investigate the techniques that could be followed in order to retrofit old DSs. This is important to follow up with the change in the district generations.

References

- [1] R. Lazzarin, Heat pumps and solar energy: A review with some insights in the future, *International Journal of Refrigeration*, Volume 116, 2020, Pages 146-160, ISSN 0140-7007, <https://doi.org/10.1016/j.ijrefrig.2020.03.031>.
- [2] Omar Ramadan, Siddig Omer, Yate Ding, Hasila Jarimi, Xiangjie Chen, Saffa Riffat, Economic evaluation of installation of standalone wind farm and wind + CAES system for the new regulating tariffs for renewables in Egypt, *Thermal Science and Engineering Progress*, Volume 7, 2018, Pages 311-325, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.06.005>.
- [3] Vijay Chauhan, P. Anil Kishan, Sateesh Gedupudi, Thermodynamic analysis of a combined cycle for cold storage and power generation using geothermal heat source, *Thermal Science and Engineering Progress*, Volume 11, 2019, Pages 19-27, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2019.03.009>.
- [4] S.J. Mandley, V. Daioglou, H.M. Junginger, D.P. van Vuuren, B. Wicke, EU bioenergy development to 2050, *Renewable and Sustainable Energy Reviews*, Volume 127, 2020, 109858, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2020.109858>.
- [5] Bassel Soudan, Community-scale baseload generation from marine energy, *Energy*, Volume 189, 2019, 116134, ISSN 0360-5442, <https://doi.org/10.1016/j.energy.2019.116134>.
- [6] Truong Nguyen, Leif Gustavsson, Production of district heat, electricity and/or biomotor fuels in renewable-based energy systems, *Energy*, Volume 202, 2020, 117672, ISSN 0360-5442, <https://doi.org/10.1016/j.energy.2020.117672>.
- [7] Niccolò Aste, Paola Caputo, Claudio Del Pero, Giulio Ferla, Harold Enrique Huerto-Cardenas, Fabrizio Leonforte, Alessandro Miglioli, A renewable energy scenario for a new low carbon settlement in northern Italy: Biomass district heating coupled with heat pump and solar photovoltaic system, *Energy*, Volume 206, 2020, 118091, ISSN 0360-5442, <https://doi.org/10.1016/j.energy.2020.118091>.

- [8] Junpeng Huang, Jianhua Fan, Simon Furbo, Demonstration and optimization of a solar district heating system with ground source heat pumps, *Solar Energy*, Volume 202, 2020, Pages 171-189, ISSN 0038-092X, <https://doi.org/10.1016/j.solener.2020.03.097>.
- [9] S. Srinivasa Murthy, Pradip Dutta, Badri S. Rao, Rakesh Sharma, Performance analysis of a stand-alone polygeneration microgrid, *Thermal Science and Engineering Progress*, Volume 19, 2020, 100623, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2020.100623>.
- [10] S. Srinivasa Murthy, Pradip Dutta, Rakesh Sharma, Badri S. Rao, Parametric studies on a stand-alone polygeneration microgrid with battery storage, *Thermal Science and Engineering Progress*, Volume 19, 2020, 100608, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2020.100608>.
- [11] Ijaodola, O., Ogungbemi, E., Khatib, F. N., Wilberforce, T., Ramadan, M., El Hassan, Z., Thompson, J., & Olabi, A. G. (2018). Evaluating the effect of metal bipolar plate coating on the performance of proton exchange membrane fuel cells. *Energies*, 11(11), [3203]. <https://doi.org/10.3390/en11113203>.
- [12] Ahmad Baroutaji, Tabbi Wilberforce, Mohamad Ramadan, Abdul Ghani Olabi, Comprehensive investigation on hydrogen and fuel cell technology in the aviation and aerospace sectors, *Renewable and Sustainable Energy Reviews*, Volume 106, 2019, Pages 31-40, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2019.02.022>.
- [13] Antonio Rosato, Antonio Ciervo, Giovanni Ciampi, Michelangelo Scorpio, Francesco Guarino, Sergio Sibilio, Impact of solar field design and back-up technology on dynamic performance of a solar hybrid heating network integrated with a seasonal borehole thermal energy storage serving a small-scale residential district including plug-in electric vehicles, *Renewable Energy*, Volume 154, 2020, Pages 684-703, ISSN 0960-1481, <https://doi.org/10.1016/j.renene.2020.03.053>.
- [14] Juan Pablo Jiménez Navarro; José Manuel Cejudo López; David Connolly, The effect of feed-in-tariff supporting schemes on the viability of a district heating and cooling production system, *Energy*, 134 (2017) 438-448. doi:10.1016/j.energy.2017.05.174.
- [15] Moa Swing Gustafsson, Jonn Are Myhren, Erik Dotzauer, Potential for district heating to lower peak electricity demand in a medium-size municipality in Sweden, *Journal of Cleaner Production*, 186 (2018) 1-9. doi:10.1016/j.jclepro.2018.03.038.
- [16] David Hawkey; Janette Webb; Mark Winskel, Organisation and governance of urban energy systems: district heating and cooling in the UK, *Journal of Cleaner Production*, doi:10.1016/j.jclepro.2012.11.018.

- [17] Mohammad Sameti, Fariborz Haghigha, Optimization approaches in district heating and cooling thermal network, *Energy & Buildings*, 140 (2017) 121-130. doi:10.1016/j.enbuild.2017.01.062.
- [18] Sven Werner, International review of district heating and cooling, *Energy*, 137 (2017) 617-631. doi:10.1016/j.energy.2017.04.045.
- [19] Torun Hammar, Fabian Levihn, Time-dependent climate impact of biomass use in a fourth generation district heating system, including BECCS, *Biomass and Bioenergy*, Volume 138, 2020, 105606, ISSN 0961-9534, <https://doi.org/10.1016/j.biombioe.2020.105606>.
- [20] Andrew Lake, Behnaz Rezaie, Steven Beyerlein, Review of district heating and cooling systems for a sustainable future, *Renewable and Sustainable Energy Reviews*, 67 + (2016) 417-425. doi:10.1016/j.rser.2016.09.061.
- [21] Mikel Lumberras, Roberto Garay, Energy & economic assessment of façade-integrated solar thermal systems combined with ultra-low temperature district-heating, *Renewable Energy*, Volume 159, 2020, Pages 1000-1014, ISSN 0960-1481, <https://doi.org/10.1016/j.renene.2020.06.019>.
- [22] Mohammad Sameti; Fariborz Haghighat, Optimization of 4th generation distributed district heating system: Design and planning of combined heat and power, *Renewable Energy*, doi:10.1016/j.renene.2018.06.068.
- [23] Simone Buffa; Marco Cozzini; Matteo D'Antoni; Marco Baratieri; Roberto Fedrizzi, 5th generation district heating and cooling systems_ A review of existing cases in Europe, *Renewable and Sustainable Energy Reviews*, 104 (2019) 504-522. doi:10.1016/j.rser.2018.12.059.
- [24] Justus von Rhein; Gregor P. Henze; Nicholas Long; Yangyang Fu, Development of a topology analysis tool for fifth-generation district heating and cooling networks, *Energy Conversion and Management*, 196 (2019) 705-716. doi:10.1016/j.enconman.2019.05.066.
- [25] Marwan Abugabbara, Saqib Javed, Hans Bagge, Dennis Johansson, Bibliographic analysis of the recent advancements in modeling and co-simulating the fifth-generation district heating and cooling systems, *Energy and Buildings*, 2020, 110260, ISSN 0378-7788, <https://doi.org/10.1016/j.enbuild.2020.110260>.
- [26] Zhikun Wang; Jenny Crawley; Francis G.N. Li; Robert Lowe, Sizing of district heating systems based on smart meter data: Quantifying the aggregated domestic energy demand and demand diversity in the UK, *Energy*, 193 (2020) 116780. doi:10.1016/j.energy.2019.116780.

- [27] Lanbin Liu; Lin Fu; Yi Jiang, A new "wireless on-off control" technique for adjusting and metering household heat in district heating system, *Applied Thermal Engineering*, 36 (2012) 202-209. doi:10.1016/j.applthermaleng.2011.11.040.
- [28] Drammen Neatpump, <https://www.star-ref.co.uk/case-studies/district-heating/drammen-neatpump/> [accessed July 2020].
- [29] Richard Anderson, Heat pumps extract warmth from ice cold water, *BBC News*, 10 March 2015, <https://www.bbc.com/news/business-31506073> [accessed July 2020].
- [30] District heating in Germany, *Hot|Cool*, International magazine on district heating and cooling, 2/2013, https://dbdh.dk/download/Publications/HC2_13_LOWg.pdf [accessed July 2020].
- [31] Andrea Salomon, Keertana Lingamaneni, and Yuxuan Chen, Western Harbor, Malmo, Sweden, District Combined Heat and Power System, <https://urbanecologycmu.wordpress.com/2015/11/02/western-harbor-malmo-sweden-district-combined-heat-and-power-system/> [accessed July 2020].
- [32] Star turns up the heat at Norwegian military base, May 2011, <https://www.naturalheatni.com/wp-content/uploads/2014/09/Case-Study-No-70-Norwegian-Army.pdf> [accessed July 2020].
- [33] Andy Nolan, Sheffield & district energy network development, *Renewable Energy & Local Opportunities*, 4 July 2013, <http://yourclimate.github.io/system/files/documents/Andy%20Nolan%20-%20Sheffield%20-%20District%20Heating%20Network.pdf> [accessed July 2020].
- [34] Sam Shead, Excess heat from steel plants could be used to heat Sheffield, 14 May 2012, <https://www.theengineer.co.uk/excess-heat-from-steel-plants-could-be-used-to-heat-sheffield/> [accessed July 2020].
- [35] Urban Community Heating and Cooling: the Southampton District Energy Scheme, https://www.iea-dhc.org/fileadmin/documents/DHC_CHP_Case_Studies/KN1640_Southampton_v2.pdf [accessed July 2020].
- [36] District cooling Stockholm City, *Capital Cooling*, https://docuri.com/download/district-cooling_59c1d4b8f581710b2865d19e.pdf [accessed July 2020].
- [37] The cogeneration plants and Turin district heating system, Iren Energia, https://www.irenenergia.it/ChiSiamo/Media/brochure/files/en/Iren_Energia_Teleris_caldamento_Torino_UK.pdf [accessed July 2020].

- [38] A. Senor; D. Panepinto; G. Genon, A case study: an environmental and economic analysis of Turin District's heating system combined with a cogeneration plant, *Sustainable Development*, Vol. 2, 651-662, <http://citeseerx.ist.psu.edu/viewdoc/download?doi=10.1.1.735.1775&rep=rep1&type=pdf> [accessed July 2020].
- [39] Behnaz Rezaie; Marc A. Rosen, District heating and cooling: Review of technology and potential enhancements, *Applied Energy*, 93 (2012) 2-10. doi:10.1016/j.apenergy.2011.04.020.
- [40] Jordi Ortiga; Joan Carles Bruno; Alberto Coronas, Operational optimisation of a complex trigeneration system connected to a district heating and cooling network, *Applied Thermal Engineering*, 50 (2013) 1536-1542. doi:10.1016/j.applthermaleng.2011.10.041.
- [41] Eduard Oro; Paolo Taddeo; Jaume Salom, Waste heat recovery from urban air cooled data centres to increase energy efficiency of district heating networks, *Sustainable Cities and Society*, 45 (2018) 522-542. doi:10.1016/j.scs.2018.12.012.
- [42] Ding Lu; Gaofei Chen; Maoqiong Gong; Yin Bai; Qingyu Xu; Yanxing Zhao; Xueqiang Dong; Jun Shen, Thermodynamic and economic analysis of a gas-fired absorption heat pump for district heating with cascade recovery of flue gas waste heat, *Energy Conversion and Management*, 185 (2019) 87-100. doi:10.1016/j.enconman.2019.01.110.
- [43] Roozbeh Sangi, Pooyan Jahangiri, Alexander Thamm, Dirk Müller, Dynamic exergy analysis – Modelica®-based tool development: A case study of CHP district heating in Bottrop, Germany, *Thermal Science and Engineering Progress*, Volume 4, 2017, Pages 231-240, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2017.10.008>.
- [44] Jing Zeng; Jie Han; Guoqiang Zhang, Diameter optimization of district heating and cooling piping network based on hourly load, *Applied Thermal Engineering*, 107 (2016) 750-757. doi:10.1016/j.applthermaleng.2016.07.037.
- [45] Z.X. Jing; X.S. Jiang; Q.H. Wu; W.H. Tang; B. Hua, Modelling and optimal operation of a small-scale integrated energy based district heating and cooling system, *Energy*, doi:10.1016/j.energy.2014.06.030.
- [46] Jiawei Wang; Shi You; Yi Zong; Hanmin Cai; Chresten Traeholt; Zhao Yang Dong, Investigation of real-time flexibility of combined heat and power plants in district heating applications, *Applied Energy*, 237 (2019) 196-209. doi:10.1016/j.apenergy.2019.01.017.
- [47] D. Lončar; I. Ridjan, Medium term development prospects of cogeneration district heating systems in transition country - Croatian case, *Energy*, 48 (2012) 32-39. doi:10.1016/j.energy.2012.07.025.

- [48] José P. Paredes-Sánchez; M. Conde; M.A. Gómez; D. Alves, Modelling hybrid thermal systems for district heating: A pilot project in wood transformation industry, *Journal of Cleaner Production*, 194 (2018) 726-734. doi:10.1016/j.jclepro.2018.05.170.
- [49] Chien-Yeh Hsu; Tzu-Yuan Lin; Jyun-De Liang; Ching-Hsien Lai; Sih-Li Chen, Optimization analysis of waste heat recovery district cooling system on a remote island_ Case study Green Island, *Energy Conversion and Management*, 183 (2019) 660-670. doi:10.1016/j.enconman.2019.01.028.
- [50] Masakazu Ito; Akihisa Takano; Takao Shinji; Takahiro Yagi; Yasuhiro Hayashi, Electricity adjustment for capacity market auction by a district heating and cooling system, *Applied Energy*, 206 (2017) 623-633. doi:10.1016/j.apenergy.2017.08.210.
- [51] Natalia Kabalina; Mario Costa; Weihong Yang; Andrew Martin, Energy and Economic Assessment of a Polygeneration District Heating and Cooling System Based on Gasification of Refuse Derived Fuels, *Energy*, doi:10.1016/j.energy.2017.06.110.
- [52] Natalia Kabalina; Mário Costa; Weihong Yang; Andrew Martin; Massimo Santarelli, Exergy analysis of a polygeneration-enabled district heating and cooling system based on gasification of refuse derived fuel, *Journal of Cleaner Production*, 141 (2017) 760-773 . doi:10.1016/j.jclepro.2016.09.151.
- [53] Ingo Karschin; Jutta Geldermann, Efficient cogeneration and district heating systems in bioenergy villages: an optimization approach, *Journal of Cleaner Production*, doi:10.1016/j.jclepro.2015.03.086.
- [54] Pedro A. Rodriguez-Aumente; María del Carmen Rodriguez-Hidalgo; José I. Nogueira; Antonio Lecuona; María del Carmen Venegas, District heating and cooling for business buildings in Madrid, *Applied Thermal Engineering*, 50 (2013) 1496-1503. doi:10.1016/j.applthermaleng.2011.11.036.
- [55] Sam J. Cox; Dongsu Kim; Heejin Cho; Pedro Mago, Real time optimal control of district cooling system with thermal energy storage using neural networks, *Applied Energy*, 238 (2019) 466-480. doi:10.1016/j.apenergy.2019.01.093.
- [56] Alberto Carotenuto, Rafal Damian Figaj, Laura Vanoli, A novel solar-geothermal district heating, cooling and domestic hot water system: Dynamic simulation and energy-economic analysis, *Energy*, doi:10.1016/j.energy.2017.08.084.
- [57] Paolo Iodice; Massimo Dentice d'Accadia; Carmelina Abagnale; Massimo Cardone, Energy, economic and environmental performance appraisal of a trigeneration power plant for a new district: Advantages of using a renewable fuel, *Applied Thermal Engineering*, 95 (2015) 330-338. doi:10.1016/j.applthermaleng.2015.11.017.

- [58] Renaldi Renaldi; Daniel Friedrich, Techno-economic analysis of a solar district heating system with seasonal thermal storage in the UK, *Applied Energy*, 236 (2019) 388-400. doi:10.1016/j.apenergy.2018.11.030.
- [59] Michele Cordioli; Simone Vincenzi; Giulio A. De Leo, Effects of heat recovery for district heating on waste incineration health impact: A simulation study in Northern Italy, *Science of the Total Environment*, 444 (2013) 369-380. doi:10.1016/j.scitotenv.2012.11.079.
- [60] Paweł Gładysz; Andrzej Ziębik, Complex analysis of the optimal coefficient of the share of cogeneration in district heating systems, *Energy*, 62 (2013) 12-22. doi:10.1016/j.energy.2013.04.032.
- [61] B. van der Heijde; M. Fuchs; C. Ribas Tugores; G. Schweiger; K. Sartor; D. Basciotti; D. Müller; C. Nytsch-Geusen; M. Wetter; L. Helsen, Dynamic equation-based thermo-hydraulic pipe model for district heating and cooling systems, *Energy Conversion and Management*, 151 (2017) 158-169. doi:10.1016/j.enconman.2017.08.072.
- [62] Mohammad Sameti; Fariborz Haghghat, Hybrid solar and heat-driven district cooling system_ Optimal integration and control strategy, *Solar Energy*, 183 (2019) 260-275. doi:10.1016/j.solener.2019.03.034.
- [63] Felix Bünning; Michael Wetter; Marcus Fuchs; Dirk Müller, Bidirectional low temperature district energy systems with agent-based control_ Performance comparison and operation optimization, *Applied Energy*, doi:10.1016/j.apenergy.2017.10.072.
- [64] Yong-Hoon Im; Jie Liu, Feasibility study on the low temperature district heating and cooling system with bi-lateral heat trades model, *Energy*, 153 (2018) 988-999. doi:10.1016/j.energy.2018.04.094.
- [65] Bin Hu; Hua Liu; R.Z. Wang; Hongbo Li; Zhiping Zhang; Sheng Wang, A High-Efficient Centrifugal Heat Pump with Industrial Waste Heat Recovery for District Heating, *Applied Thermal Engineering*, doi:10.1016/j.applthermaleng.2017.07.030.
- [66] María Uris; José Ignacio Linares; Eva Arenas, Size optimization of a biomass-fired cogeneration plant CHP/CCHP (Combined heat and power/Combined heat, cooling and power) based on Organic Rankine Cycle for a district network in Spain, *Energy*, doi:10.1016/j.energy.2015.07.054.
- [67] Mohammad Ameri; Zahed Besharati, Optimal design and operation of district heating and cooling networks with CCHP systems in a residential complex, *Energy & Buildings*, 110 (2016) 135-148. doi:10.1016/j.enbuild.2015.10.050.

- [68] Na Deng; Guansong He; Yuan Gao; Bin Yang; Jun Zhao; Shunming He; Xue Tian, Comparative analysis of optimal operation strategies for district heating and cooling system based on design and actual load, *Applied Energy*, 205 (2017) 577-588. doi:10.1016/j.apenrgy.2017.07.104.
- [69] Hasan Huseyin Erdem, Ali Volkan Akkaya, Ahmet Dagdas, Suleyman Hakan Sevilgen, Burhanettin Cetin, Bahri Sahin, Ismail Teke, Cengiz Gungor, Selcuk Atas, Mehmet Zahit Basak, Renovating thermal power plant to trigeneration system for district heating/cooling: Evaluation of performance variation, *Applied Thermal Engineering*, 86 (2015) 35-42. doi:10.1016/j.applthermaleng.2015.04.030.
- [70] Mikko Kouhia; Timo Laukkanen; Henrik Holmberg; Pekka Ahtila, District heat network as a short-term energy storage, *Energy*, doi:10.1016/j.energy.2019.04.082.
- [71] Anes Kazagic; Ajla Merzic; Elma Redzic; Dino Tresnjo, Optimization of modular district heating solution based on CHP and RES - Demonstration case of the Municipality of Visoko, *Energy*, 181 (2019) 56-65. doi:10.1016/j.energy.2019.05.132.
- [72] Li Xiang-li, Duanmu Lin, Shu Hai-wen, Optimal design of district heating and cooling pipe network of seawater-source heat pump, *Energy and Buildings* 42 (2010) 100–104, doi:10.1016/j.enbuild.2009.07.016.
- [73] Hasan Huseyin Erdem; Ahmet Dagdas; Suleyman Hakan Sevilgen; Burhanettin Cetin; Ali Volkan Akkaya; Bahri Sahin; Ismail Teke; Cengiz Gungor; Selcuk Atas, Thermodynamic analysis of an existing coal-fired power plant for district heating/cooling application, *Applied Thermal Engineering* 30 (2010) 181–187, doi:10.1016/j.applthermaleng.2009.08.003.
- [74] Antonio Colmenar-Santos; Enrique Rosales-Asensio; David Borge-Diez; Jorge-Juan Blanes-Peiró, District heating and cogeneration in the EU-28_ Current situation, potential and proposed energy strategy for its generalisation, *Renewable and Sustainable Energy Reviews*, 62 + (2016) 621-639. doi:10.1016/j.rser.2016.05.004.
- [75] Hussam Jouhara, Abdul Ghani Olabi, Editorial: Industrial waste heat recovery, *Energy*, Volume 160, 2018, Pages 1-2, ISSN 0360-5442, <https://doi.org/10.1016/j.energy.2018.07.013>.
- [76] Hussam Jouhara, Navid Khordehgah, Sulaiman Almahmoud, Bertrand Delpech, Amisha Chauhan, Savvas A. Tassou, Waste heat recovery technologies and applications, *Thermal Science and Engineering Progress*, Volume 6, 2018, Pages 268-289, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.04.017>.
- [77] Giuseppe Bianchi, Rebecca McGinty, David Oliver, Derek Brightman, Obadah Zaher, Savvas A. Tassou, Jeremy Miller, Hussam Jouhara, Development and analysis of a packaged Trilateral Flash Cycle system for low grade heat to power conversion

- applications, *Thermal Science and Engineering Progress*, Volume 4, 2017, Pages 113-121, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2017.09.009>.
- [78] Kristina Lygnerud; Sven Werner, Risk assessment of industrial excess heat recovery in district heating systems, *Energy*, 151 (2018) 430-441. doi:10.1016/j.energy.2018.03.047.
- [79] Martin Thalfeldt; Jarek Kurnitski; Eduard Latosov, Exhaust air heat pump connection schemes and balanced heat recovery ventilation effect on district heat energy use and return temperature, *Applied Thermal Engineering*, 128 (2018) 402-414. doi:10.1016/j.applthermaleng.2017.09.033.
- [80] Jingyi Wang; Zhe Wang; Ding Zhou; Kaiyu Sun, Key issues and novel optimization approaches of industrial waste heat recovery in district heating systems, *Energy*, 188 (2019) 116005. doi:10.1016/j.energy.2019.116005.
- [81] Pawel Regucki, Marek Lewkowicz, Renata Krzyżyńska, Hussam Jouhara, Numerical study of water flow rates in power plant cooling systems, *Thermal Science and Engineering Progress*, Volume 7, 2018, Pages 27-32, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.04.015>.
- [82] Pawel Regucki, Renata Krzyżyńska, Zbyszek Szeliga, Hussam Jouhara, Mathematical model of sulphate ion concentration in a closed cooling system of a power plant, *Thermal Science and Engineering Progress*, Volume 4, 2017, Pages 160-167, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2017.09.012>.
- [83] Shoaib Khanmohammadi, Kazem Atashkari, Modeling and multi-objective optimization of a novel biomass feed polygeneration system integrated with multi effect desalination unit, *Thermal Science and Engineering Progress*, Volume 8, 2018, Pages 269-283, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.08.003>.
- [84] Hussam Jouhara, Marderos A. Sayegh, Energy efficient thermal systems and processes, *Thermal Science and Engineering Progress*, Volume 7, 2018, Pages e1-e2, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.07.016>.
- [85] D. Czajczyńska, L. Anguilano, H. Ghazal, R. Krzyżyńska, A.J. Reynolds, N. Spencer, H. Jouhara, Potential of pyrolysis processes in the waste management sector, *Thermal Science and Engineering Progress*, Volume 3, 2017, Pages 171-197, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2017.06.003>.
- [86] Hussam Jouhara, Darem Ahmad, Inge van den Boogaert, Evina Katsou, Stefaan Simons, Nik Spencer, Pyrolysis of domestic based feedstock at temperatures up to 30 °C, *Thermal Science and Engineering Progress*, Volume 5, 2018, Pages 117-143, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2017.11.007>.

- [87] Abdul Ghani Olabi; Montaser Mahmoud; Bassel Soudan; Tabbi Wilberforce; Mohamad Ramadan, Geothermal based hybrid energy systems, toward eco-friendly energy approaches, *Renewable Energy*, 147 (2020) 2003-2012. doi:10.1016/j.renene.2019.09.140.
- [88] Bilal Lamrani, Abdeslam Draoui, Modelling and simulation of a hybrid solar-electrical dryer of wood integrated with latent heat thermal energy storage system, *Thermal Science and Engineering Progress*, Volume 18, 2020, 100545, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2020.100545>.
- [89] Omar Mohammed Hamdoon, Omar Rafae Alomar, Badran Mohammed Salim, Performance analysis of hybrid photovoltaic thermal solar system in Iraq climate condition, *Thermal Science and Engineering Progress*, Volume 17, 2020, 100359, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2019.100359>.
- [90] Amirhosein Shahhosseini, Javad Olamaei, An efficient stochastic programming for optimal allocation of combined heat and power systems for commercial buildings using, *Thermal Science and Engineering Progress*, Volume 11, 2019, Pages 133-141, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2019.03.016>.
- [91] Mattia De Rosa, Mark Carragher, Donal P. Finn, Flexibility assessment of a combined heat-power system (CHP) with energy storage under real-time energy price market framework, *Thermal Science and Engineering Progress*, Volume 8, 2018, Pages 426-438, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.10.002>.
- [92] Antonio Colmenar-Santos; Enrique Rosales-Asensio; David Borge-Diez; Eduardo Collado-Fernández, Evaluation of the cost of using power plant reject heat in low-temperature district heating and cooling networks, *Applied Energy*, 162 (2016) 892-907. doi:10.1016/j.apenergy.2015.10.161.
- [93] Nahid Mohammadkhani, Mostafa Sedighzadeh, Masoud Esmaili, Energy and emission management of CCHPs with electric and thermal energy storage and electric vehicle, *Thermal Science and Engineering Progress*, Volume 8, 2018, Pages 494-508, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.10.005>.
- [94] Fabrizio Ascione; Michele Canelli; Rosa Francesca De Masi; Maurizio Sasso; Giuseppe Peter Vanoli, Combined cooling, heating and power for small urban districts: an Italian case-study, *Applied Thermal Engineering*, doi:10.1016/j.applthermaleng.2013.10.058.
- [95] R.S. Mishra, Harwinder Singh, Detailed parametric analysis of solar driven supercritical CO₂ based combined cycle for power generation, cooling and heating effect by vapor absorption refrigeration as a bottoming cycle, *Thermal Science and Engineering Progress*, Volume 8, 2018, Pages 397-410, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2018.09.013>.

- [96] Abdulrahman Dahash; Fabian Ochs; Michele Bianchi Janetti; Wolfgang Streicher, Advances in seasonal thermal energy storage for solar district heating applications_ A critical review on large-scale hot-water tank and pit thermal energy storage systems, *Applied Energy*, 239 (2019) 296-315. doi:10.1016/j.apenergy.2019.01.189.
- [97] Elisa Guelpa; Vittorio Verda, Thermal energy storage in district heating and cooling systems_ A review, *Applied Energy*, 252 (2019) 113474. doi:10.1016/j.apenergy.2019.113474.
- [98] Behrang Talebi; Fariborz Haghighat; Paul Tuohy; Parham A. Mirzaei, Optimization of a hybrid community district heating system integrated with thermal energy storage system, *Journal of Energy Storage*, 23 (2019) 128-137. doi:10.1016/j.est.2019.03.006.
- [99] Bram van der Heijde; Annelies Vandermeulen; Robbe Salenbien; Lieve Helsen, Representative days selection for district energy system optimisation_ a solar district heating system with seasonal storage, *Applied Energy*, 248 (2019) 79-94. doi:10.1016/j.apenergy.2019.04.030.
- [100] Antonio Rosato, Antonio Ciervo, Giovanni Ciampi, Michelangelo Scorpio, Francesco Guarino, Sergio Sibilio, Energy, environmental and economic dynamic assessment of a solar hybrid heating network operating with a seasonal thermal energy storage serving an Italian small-scale residential district: Influence of solar and back-up technologies, *Thermal Science and Engineering Progress*, Volume 19, 2020, 100591, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2020.100591>.
- [101] Maan Al-Zareer; Ibrahim Dincer; Marc A. Rosen, Analysis and Assessment of Novel Liquid Air Energy Storage System with District Heating and Cooling Capabilities, *Energy*, doi:10.1016/j.energy.2017.09.094.
- [102] Montaser Mahmoud, Mohamad Ramadan, Abdul-Ghani Olabi, Keith Pullen, Sumsun Naher, A review of mechanical energy storage systems combined with wind and solar applications, *Energy Conversion and Management*, Volume 210, 2020, 112670, ISSN 0196-8904, <https://doi.org/10.1016/j.enconman.2020.112670>.
- [103] S.M. Mousavi G, Faramarz Faraji, Abbas Majazi, Kamal Al-Haddad, A comprehensive review of Flywheel Energy Storage System technology, *Renewable and Sustainable Energy Reviews*, Volume 67, 2017, Pages 477-490, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2016.09.060>.
- [104] Giovanna Cavazzini, Jean-Bernard Houdeline, Giorgio Pavesi, Olivier Teller, Guido Ardizzon, Unstable behaviour of pump-turbines and its effects on power regulation capacity of pumped-hydro energy storage plants, *Renewable and Sustainable Energy Reviews*, Volume 94, 2018, Pages 399-409, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2018.06.018>.

- [105] Jie Song, Xiaodong Peng, Xiangjun Fang, Ying Han, Zhanfeng Deng, Guizhi Xu, Lixiao Liang, Jibiao Hou, Hongwei Wu, Thermodynamic analysis and algorithm optimisation of a multi-stage compression adiabatic compressed air energy storage system, *Thermal Science and Engineering Progress*, Volume 19, 2020, 100598, ISSN 2451-9049, <https://doi.org/10.1016/j.tsep.2020.100598>.
- [106] Antonio Rosato; Antonio Ciervo; Giovanni Ciampi; Michelangelo Scorpio; Sergio Sibilio, Impact of seasonal thermal energy storage design on the dynamic performance of a solar heating system serving a small-scale Italian district composed of residential and school buildings, *Journal of Energy Storage*, 25 (2019) 100889. doi:10.1016/j.est.2019.100889.
- [107] Yoshiyuki Kozawa, Naoki Aizawa, Masayuki Tanino, Study on ice storing characteristics in dynamic-type ice storage system by using supercooled water. Effects of the supplying conditions of ice-slurry at deployment to district heating and cooling system, *International Journal of Refrigeration* 28 (2005) 73–82, doi:10.1016/j.ijrefrig.2004.07.017.
- [108] Dan Wang; Yun-qiang Zhi; Hong-jie Jia; Kai Hou; Shen-xi Zhang; Wei Du; Xu-dong Wang; Meng-hua Fan, Optimal scheduling strategy of district integrated heat and power system with wind power and multiple energy stations considering thermal inertia of buildings under different heating regulation modes, *Applied Energy*, 240 (2019) 341-358. doi:10.1016/j.apenergy.2019.01.199.
- [109] Katarzyna M. Luc, Rongling Li, Luyi Xu, Toke R. Nielsen, Jan L.M. Hensen, Energy flexibility potential of a small district connected to a district heating system, *Energy and Buildings*, 2020, 110074, ISSN 0378-7788, <https://doi.org/10.1016/j.enbuild.2020.110074>.
- [110] Itzal del Hoyo Arce; Saioa Herrero López; Susana López Perez; Miika Rämä; Krzysztof Klobut; Jesus A. Febres, Models for fast modelling of district heating and cooling networks, *Renewable and Sustainable Energy Reviews*, 82 (2017) 1863-1873. doi:10.1016/j.rser.2017.06.109 .
- [111] Masatoshi Sakawa; Takeshi Matsui, Fuzzy multiobjective nonlinear operation planning in district heating and cooling plants, *Fuzzy Sets and Systems*, 1-12. doi:10.1016/j.fss.2011.10.020.
- [112] Antti Peltokorpi; Madis Talmar; Klaus Castren; Jan Holmstrom, Designing an organizational system for economically sustainable demand-side management in district heating and cooling, *Journal of Cleaner Production*, 219 (2019) 433-442. doi:10.1016/j.jclepro.2019.02.106.

- [113] Pengfei Jie; Fuchun Yan; Jing Li; Yumei Zhang; Zhimei Wen, Optimizing the insulation thickness of walls of existing buildings with CHP-based district heating systems, *Energy*, 116262. doi:10.1016/j.energy.2019.116262.
- [114] Tobias Sommer; Stefan Mennel; Matthias Sulzer, Lowering the pressure in district heating and cooling networks by alternating the connection of the expansion vessel, *Energy*, doi:10.1016/j.energy.2019.02.010.